

DOCUMENT 00 90 01 – ADDENDUM NO. 1

PROJECT: Inter-Garrison Road Water Distribution Pipeline
CIP NO.: OW-2421

FROM: District Engineer
Marina Coast Water District
920 2nd Avenue, Suite A
Marina, CA 93933

TO: **Prospective Bidders**

This Addendum forms a part of the Bidding Documents and will be incorporated into Contract Documents. Insofar as the Specifications or Drawings or both are inconsistent, this Addendum governs. Acknowledge receipt of the Addendum by inserting its number in Document 00 41 00 – Bid Form. **FAILURE TO DO SO WILL SUBJECT BID TO DISQUALIFICATION.**

PART 1 – BIDDER INFORMATION ITEMS

- A. The Engineer's Estimate for the projects is \$830,000.

PART 2 - CHANGES TO PROJECT MANUAL

- A. Changes made to Document 00 41 00. Please use the updated document attached as Exhibit A.
- B. Changes made to Document 00 43 93. Please use the updated document attached as Exhibit B.

PART 3 - CHANGES TO DRAWINGS

- A. A steel casing pipe was added at one (1) location per sheet No. 6. The PDF provided reflects this change, attached as Exhibit C.

PART 4 – QUESTIONS RECEIVED

- Q1 What is the Engineer's estimate?
A1 The Engineer's Estimate for the project is provided above.
- Q2 Was the pre-bid meeting mandatory?
A2 The pre-bid meeting was **not** mandatory.
- Q3 Is the contractor responsible for the compaction test?
A3 Yes, the contractor is responsible for all compaction testing necessary for the project.
- Q4 When is construction estimated to start?

A4 MCWD desires to start construction as soon as possible once the bid is awarded. The project's estimated award date is April 22, 2025, followed by the notice to proceed (NTP) within 2 business days.

Q5 Bid Submittal Checklist Forms cannot be located within the Project Manual:

00 45 16 List of Manufacturers

00 45 34 Anti-Lobbying Certification

00 45 38 Bidder's List

A5 These three (3) forms are deemed to require submittal as part of the form 00 43 93 Bid Submittal Checklist. Please see attached for updated form 00 43 93.

Form 00 45 16 List of Manufacturers: A list of manufacturers is not needed. The approved manufacturers are already listed in the technical specifications.

Form 00 45 34 Anti-Lobbying Certification: The form is not needed as it pertains to certain project funding sources not used in this project.

Form 00 45 38 Bidder's List: The form is not needed as it pertains to certain project funding sources not used in this project.

Q6 Pages 5, 6, and 7 on the plans call for Type II slurry over the trench but the specifications state a double seal coat. Please clarify which is correct.

A6 The plans correctly identify the slurry areas with keynote #7. The Type II slurry method is to be used.

END OF DOCUMENT

EXHIBIT A

BID FORM

CIP # OW-2421, INTER-GARRISON ROAD PIPELINE UPSIZING

TABLE OF CONTENTS

	Page
ARTICLE 1 – Bid Recipient	1
ARTICLE 2 – Bidder’s Acknowledgements.....	1
ARTICLE 3 – Bidder’s Representations	1
ARTICLE 4 – Bidder’s Certification.....	2
ARTICLE 5 – Basis of Bid	3
ARTICLE 6 – Time of Completion.....	5
ARTICLE 7 – Attachments to this Bid.....	5
ARTICLE 8 – Defined Terms.....	5
ARTICLE 9 – Bid Submittal	6

ARTICLE 1 – BID RECIPIENT

1.01 This Bid is submitted to:

Marina Coast Water District
920 Second Avenue, Suite A
Marina, CA 93933
ATTN: District Engineer

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

ARTICLE 2 – BIDDER’S ACKNOWLEDGEMENTS

2.01 Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security. This Bid will remain subject to acceptance for 90 calendar after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.

ARTICLE 3 – BIDDER’S REPRESENTATIONS

3.01 In submitting this Bid, Bidder represents that:

A. Bidder has examined and carefully studied the Bidding Documents, and any data and reference items identified in the Bidding Documents, and hereby acknowledges receipt of the following Addenda:

<u>Addendum No.</u>	<u>Addendum, Date</u>
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____

- B. Bidder has visited the Site, conducted a thorough, alert visual examination of the Site and adjacent areas, and become familiar with and satisfied itself as to the general, local, and Site conditions that may affect cost, progress, and performance of the Work.
- C. Bidder is familiar with and has satisfied itself as to all Laws and Regulations that may affect cost, progress, and performance of the Work.
- D. Bidder has carefully studied all: (1) reports of explorations and tests of subsurface conditions at or adjacent to the Site and all drawings of physical conditions relating to existing surface or subsurface structures at the Site that have been identified in the Supplementary

- Conditions, especially with respect to Technical Data in such reports and drawings, and (2) reports and drawings relating to Hazardous Environmental Conditions, if any, at or adjacent to the Site that have been identified in the Supplementary Conditions, especially with respect to Technical Data in such reports and drawings.
- E. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and any Site-related reports and drawings identified in the Bidding Documents, with respect to the effect of such information, observations, and documents on (1) the cost, progress, and performance of the Work; (2) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder; and (3) Bidder's safety precautions and programs.
 - F. Bidder agrees, based on the information and observations referred to in the preceding paragraph, that no further examinations, investigations, explorations, tests, studies, or data are necessary for the determination of this Bid for performance of the Work at the price bid and within the times required, and in accordance with the other terms and conditions of the Bidding Documents.
 - G. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
 - H. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and confirms that the written resolution thereof by Engineer is acceptable to Bidder.
 - I. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for the performance and furnishing of the Work.
 - J. The submission of this Bid constitutes an incontrovertible representation by Bidder that Bidder has complied with every requirement of this Article, and that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

ARTICLE 4 – BIDDER'S CERTIFICATION

4.01 Bidder certifies that:

- A. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation;
- B. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid;
- C. Bidder has not solicited or induced any individual or entity to refrain from bidding; and
- D. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 4.01.D:
 - 1. "corrupt practice" means the offering, giving, receiving, or soliciting of any thing of value likely to influence the action of a public official in the bidding process;
 - 2. "fraudulent practice" means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at

artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition;

3. "collusive practice" means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels; and
4. "coercive practice" means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

ARTICLE 5 – BASIS OF BID

5.01 Bidder will complete the Work in accordance with the Contract Documents for the following price(s):

Item No.	Description	Unit	Estimated Quantity	Bid Unit Price	Bid Price
1	Mobilization / Demolition	LS	1		
2	Trench Safety: Temp Sheeting, Shoring and Bracing	LS	1		
3	Traffic Control	LS	1		
4	10" Class 350 ductile iron pipe in existing roadway (incl all valves, fittings, restraints, and trench saw cutting and paving)	LF	10		
5	12" Class 350 ductile iron pipe in existing roadway (incl all valves, fittings, restraints, and trench saw cutting and paving)	LF	100		
6	18" Class 250 ductile iron pipe in existing roadway (incl all valves, fittings, restraints, and trench saw cutting and paving)	LF	1,780		
7	Steel Casing Pipe, Casing Spacers, and End Seals for 18" pipe	EA	1		
8	Connect to Existing Water Main	EA	4		
9	Fire Hydrant on Proposed Main with Bollards	EA	1		
10	2" Air Release Valve	EA	1		
11	Stormwater Pollution Prevention/Erosion Control	LS	1		
Total of All Unit Price Bid Items (in numbers):					
Total of All Unit Price Bid Items (in words):					

ALW = Allowance, LF = Linear Feet, LS = Lump Sum, SY = Square Yards

Bidder acknowledges that (1) each Bid Unit Price includes an amount considered by Bidder to be adequate to cover Contractor's overhead and profit for each separately identified item, and (2) estimated quantities are not guaranteed, and are solely for the purpose of comparison of Bids, and final payment for all unit price Bid items will be based on actual quantities, determined as provided in the Contract Documents.

5.02 Bid Alternatives

- A. Bidder offers to make, at the bid alternate prices following, the changes in the Work covered by the Unit Prices that are specified in the bid alternates priced below.
- B. It is understood that:
 - 1. All bid alternate prices must be filled in.
 - 2. The acceptance or rejection of any or all of these bid alternates is at the option of the Owner.
 - 3. Acceptance or rejection of bid alternates will not necessarily be made on the basis of price alone.
 - 4. The acceptance or rejection of one or more bid alternates will not affect the Lump Sum Bid Price, nor other conditions of this Bid, nor the price of other accepted bid alternates.
 - 5. The addition or deduction shown herein for each bid alternate is the net addition or net deduction that is to be applied to the Lump Sum Bid Price of the undersigned if the bid alternate is accepted by Owner.
 - 6. The Contract Price shall be the net amount determined by applying the bid alternate prices of all accepted bid alternates to the Total Unit Price Bid.

ARTICLE 6 – TIME OF COMPLETION

- 6.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before the dates or within the number of calendar days indicated in the Agreement.
- 6.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 7 – ATTACHMENTS TO THIS BID

- 7.01 The items listed in Document 00 43 93, Bid Submittal checklist, are submitted with and made a condition of this Bid.

ARTICLE 8 – DEFINED TERMS

- 8.01 The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

ARTICLE 9 – BID SUBMITTAL

BIDDER: *[Indicate correct name of bidding entity]*

By:

[Signature]

[Printed name]

(If Bidder is a corporation, a limited liability company, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest:

[Signature]

[Printed name]

Title:

Submittal Date:

Address for giving notices:

Telephone Number:

Fax Number:

Contact Name and e-mail address:

Bidder's License No.:

(where applicable)

EXHIBIT B

BID SUBMITTAL CHECKLIST

All information required by the terms of the Bid Documents must be furnished. Important items to be submitted are including, but not limited to, those listed below:

ARTICLE 1 - SUBMIT WITH BID

	Form Number	Form Name
<input type="checkbox"/>	00 41 00	Bid Form
<input type="checkbox"/>	No form included	Certificate of Contractor's License
<input type="checkbox"/>	00 43 00	Bid Bond (or Bid Security)
<input type="checkbox"/>	00 45 12	List of Project References
<input type="checkbox"/>	00 45 14	Designation of Subcontractors
<input type="checkbox"/>	00 45 18	Designation of Insurance Agent or Broker
<input type="checkbox"/>	00 45 20	Stop Notice Information
<input type="checkbox"/>	00 45 22	Non-Collusion Statement
<input type="checkbox"/>	00 45 24	Prevailing Wage Statement
<input type="checkbox"/>	00 45 26	Public Works Contractor Registration Certification
<input type="checkbox"/>	00 45 28	Local Hiring for Public Works
<input type="checkbox"/>	00 45 30	Iran Contracting Act Certification

ARTICLE 2 – SUBMIT PRIOR TO OWNER'S EXECUTION OF CONTRACT (After Notice of Award)



<input type="checkbox"/>	00 52 00	Agreement
<input type="checkbox"/>	00 61 00	Performance Bond
<input type="checkbox"/>	00 61 50	Payment Bond
<input type="checkbox"/>	No form included	Insurance Certificates

END OF DOCUMENT

EXHIBIT C



KEYNOTES

- 1 EXISTING WATER MAIN TO REMAIN IN SERVICE. PROTECT IN PLACE.
- 2 COORDINATE THE OPERATION OF ALL EXISTING VALVES WITH MCWD STAFF.
- 3 CONNECT TO EXISTING 12" WATER LINE WITH HOT TAP PER MCWD SPECIFICATIONS. CONTRACTOR TO POTHOLE TO DETERMINE PIPE MATERIAL, EXACT LOCATION, AND DEPTH OF EXISTING WATER MAIN PRIOR TO CONSTRUCTION OR ORDERING MATERIALS. CONNECTIONS AND REMOVAL OF EXISTING PIPE TO BE COORDINATED WITH MCWD.
- 4 CONNECT TO EXISTING 18" WATER STUB PER MCWD SPECIFICATIONS. CONTRACTOR TO POTHOLE TO DETERMINE EXACT LOCATION AND DEPTH OF EXISTING WATER MAIN PRIOR TO CONSTRUCTION.
- 5 18"x12" CROSS FITTING AND 3 VALVES.
- 6 UTILITY TRENCHING PER COUNTY DETAILS ON SHEET 3. SEE KEYNOTE DELINEATIONS ON PLAN-VIEW FOR T-CUT VS EDGE OF PAVEMENT TRENCHING TYPE.
- 7 TYPE II SLURRY SEAL FROM EP TO EP AS SHOWN. CARE SHALL BE TAKEN NEAR EXISTING VALVES TO PREVENT CONCEALING VALVE COVERS.
- 8 DEFLECT PROPOSED WATER PIPE UNDER EXISTING UNDERGROUND POWER AS NECESSARY. CONTRACTOR TO POTHOLE TO DETERMINE LOCATION AND DEPTH OF EXISTING UNDERGROUND POWER PRIOR TO CONSTRUCTION OR ORDERING MATERIALS.

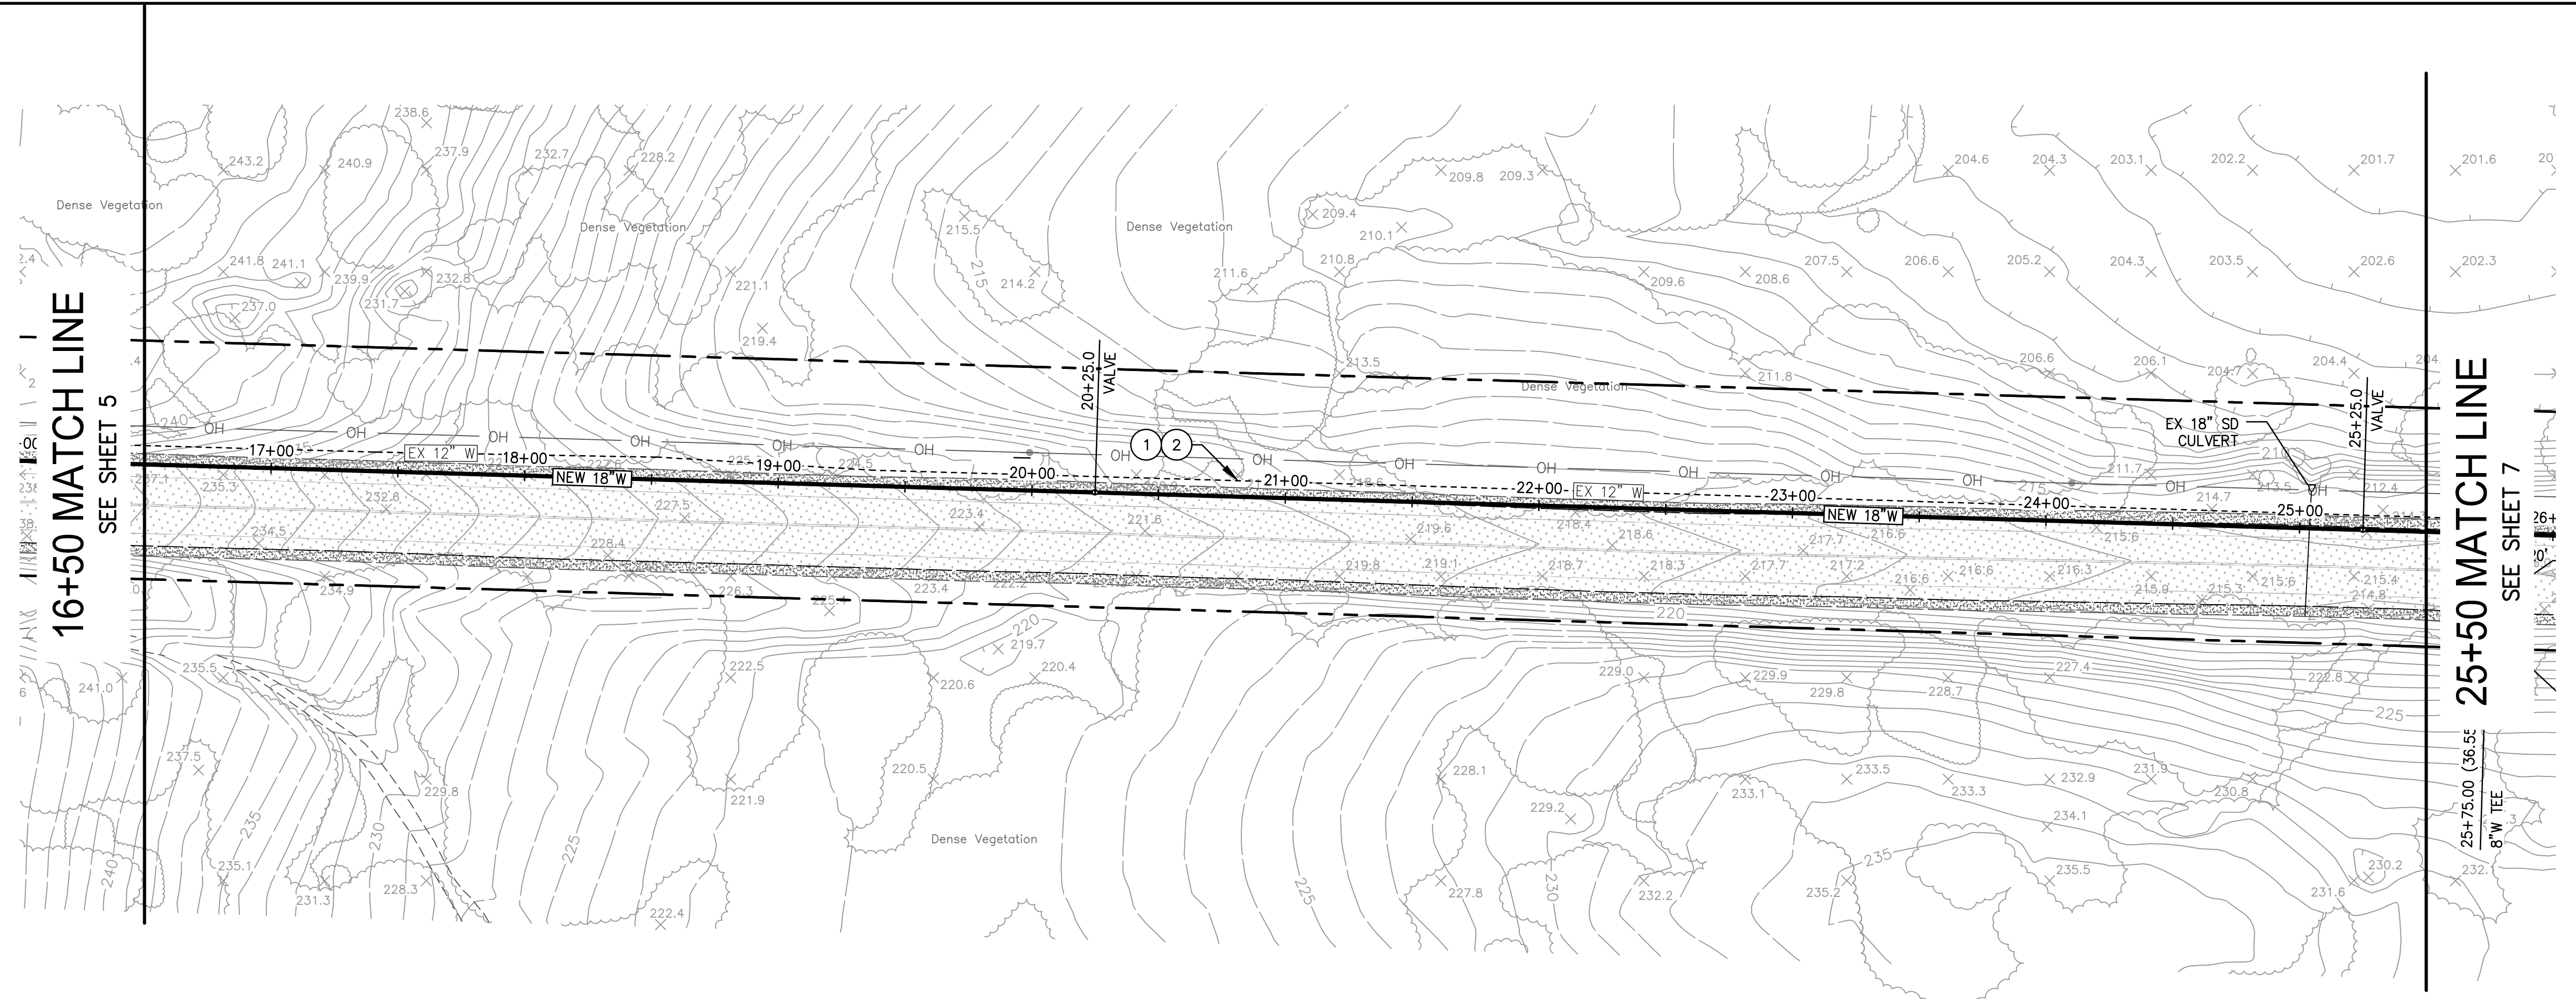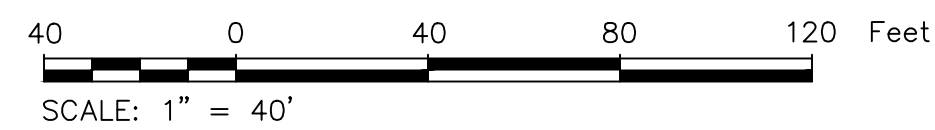

INTER-GARRISON ROAD


SCALE: HORIZONTAL 1"=40'
VERTICAL 1"=8'

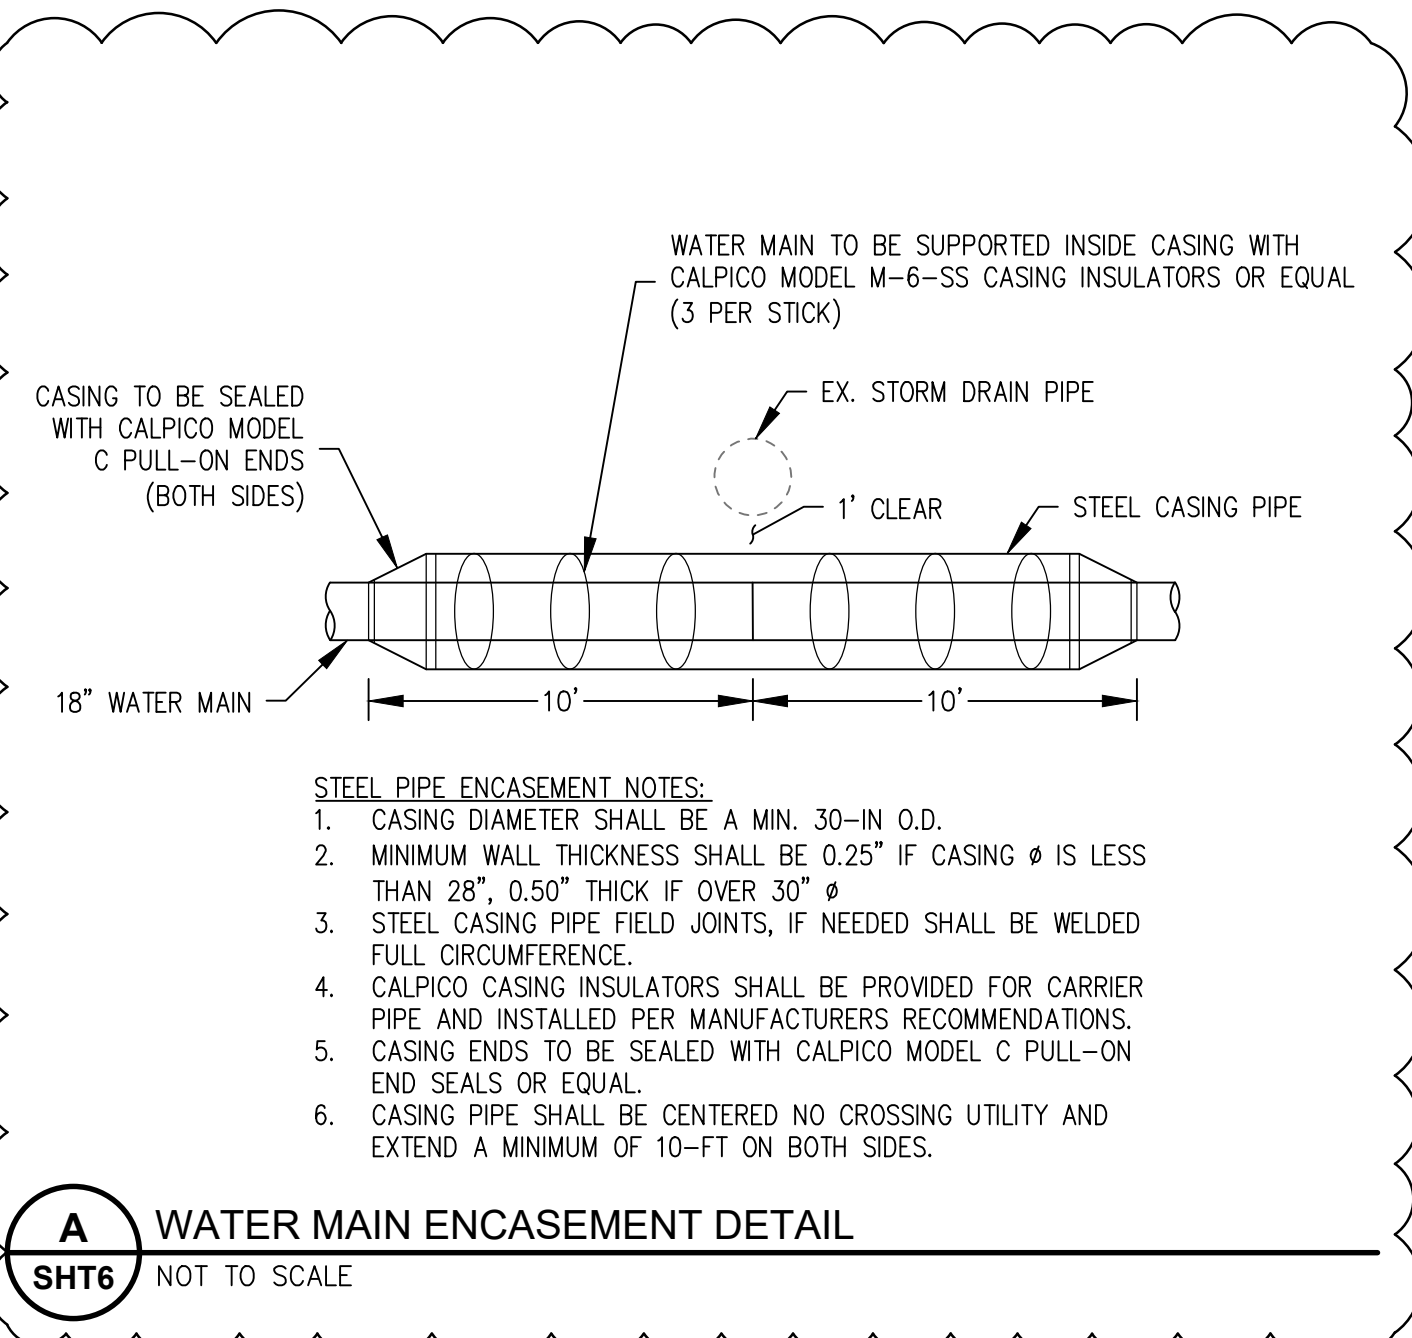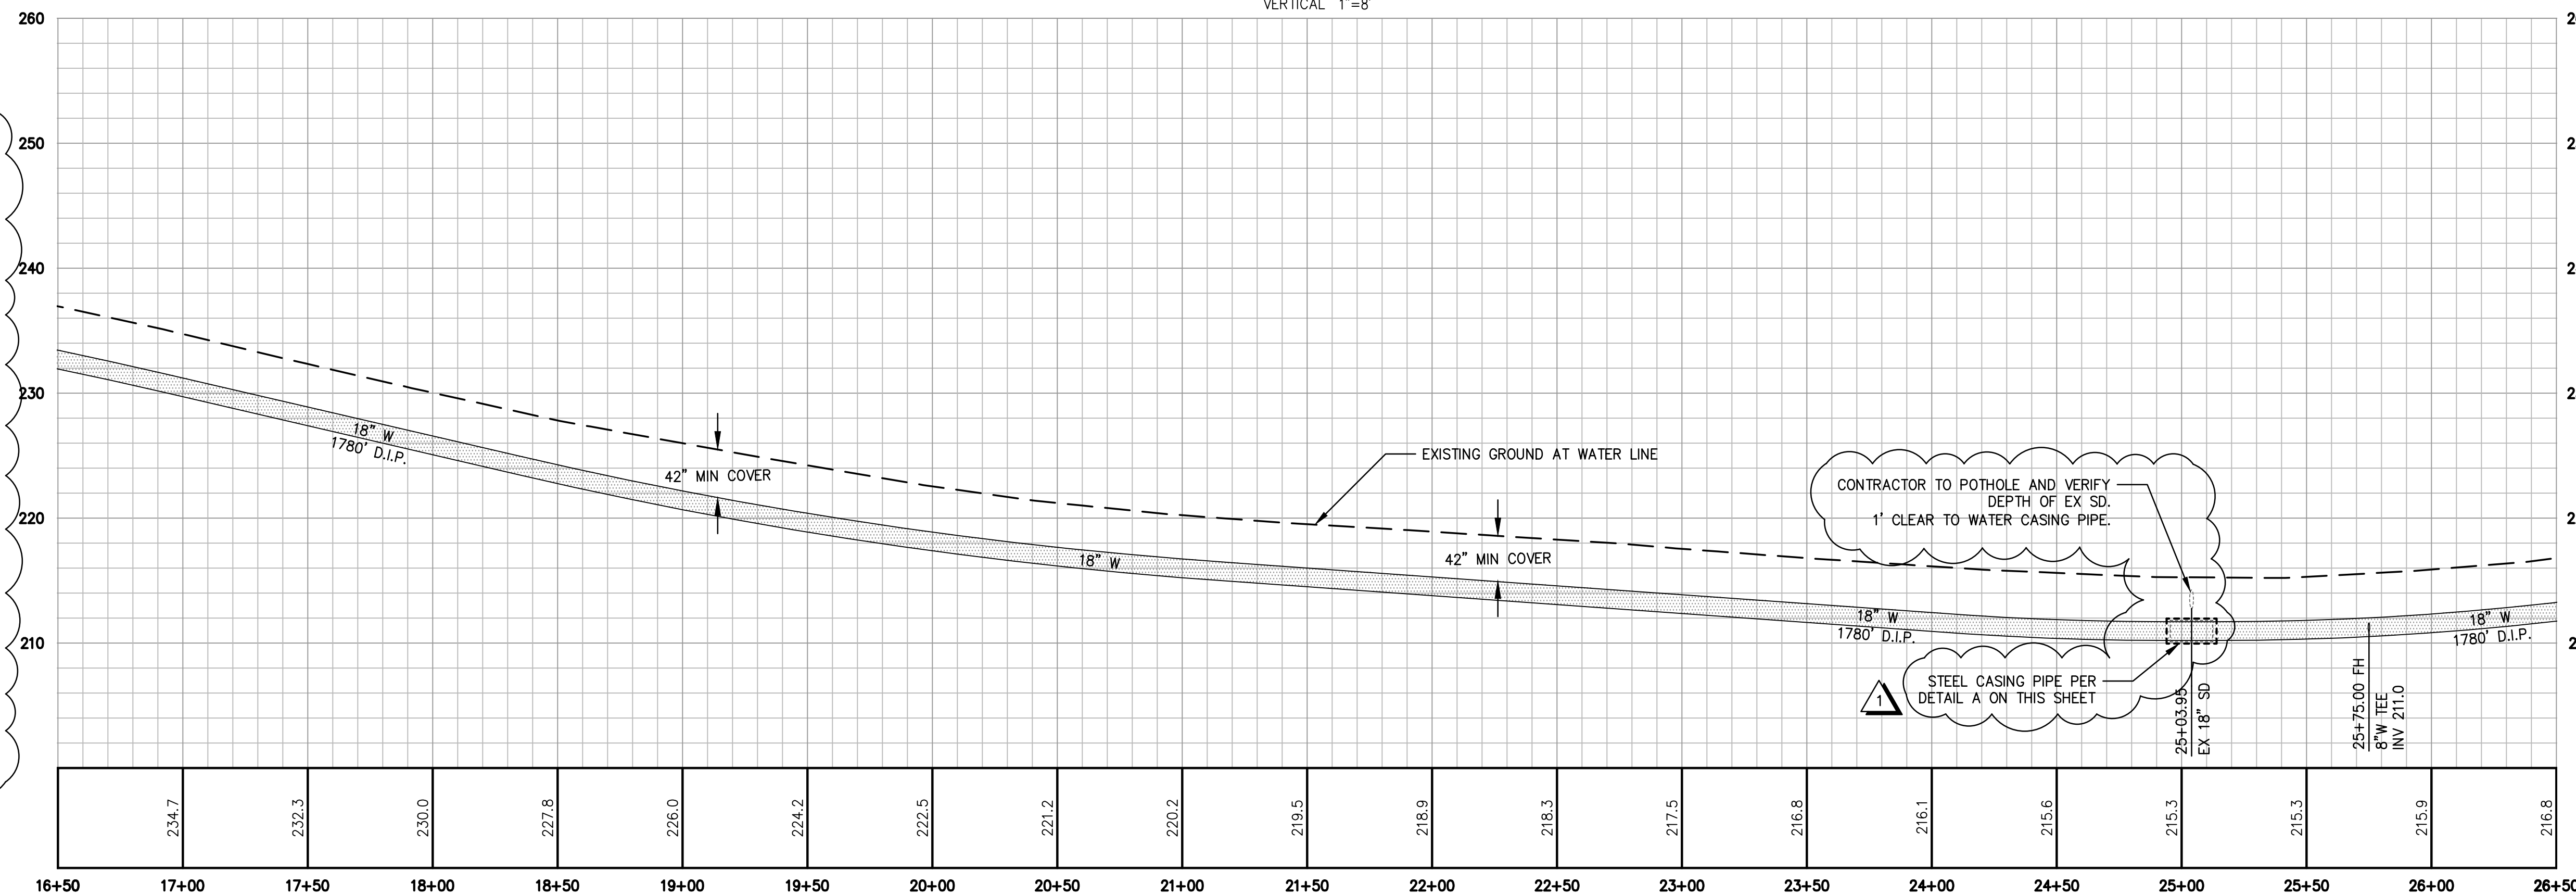

NOTE: RESTRAIN ALL PIPE JOINTS PER DETAIL ON SHEET 3 USING FIELD LOK 350 GASKETS.
RESTRAIN ALL FITTINGS USING EBAA MEGALUG SERIES 1100.



NO.	REVISION DESCRIPTION	DATE	APPR
1	STEEL CASING UNDER EX. SD CROSSING	3/24/25	

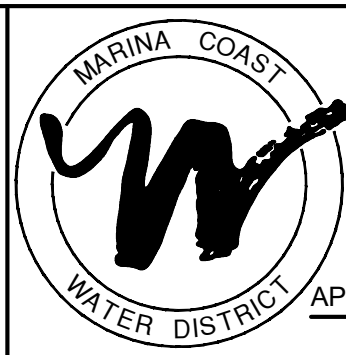

MARINA COAST WATER DISTRICT
11 RESERVATION ROAD
MARINA, CA 93933
(831) 384-6131


APPROVED FOR CONSTRUCTION:

GARRETT HAERTEL, P.E., DISTRICT ENGINEER

DATE



Civil Engineering
Land Surveying
6 Harris Court
Monterey, California
831.649.5225
whitsonengineers.com

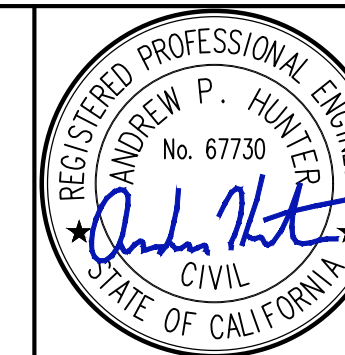

INTER-GARRISON ROAD WATER LINE
PLAN AND PROFILE STA.
16+50 - 25+50

DATE: 01/31/25
SCALE: 1"=40'
DESIGN: ML
DRAWN: ML
CHECK: APH

SHEET
6
OF
7